

Fitting instructions for the Direct Fit TRV kit for Purmo Group LST radiators

MatchMaster Lockshield Angled Valve TRV Head LST Head Extension Adaptor Radiator Valve Tail LST Casing Cover Ring/plastic bush TRV Nuts & Olives Radiator Valve Tail

Application

This kit allows a Purmo Group TRV body to be directly fitted to the radiator with the sensing head projecting beyond the enclosure. The kit also includes a manual lockshield valve (conforms to BS2767-10).

The thermostatic valve must be positioned on the flow at one of the top radiator connections. Left or Right hand fitting is allowed. Access for maintenance

is possible without disturbing plumbing connections but will involve the disconnection of the sensing head coupling unit. (See instructions below).

Fitting

- Fit the LST Radiator in the normal way following the instructions packed with the radiator.
- 2. Fit the thermostatic valve body to top of the radiator with the inlet connection facing VERTICALLY DOWNWARDS and complete other plumbing connections. The angle of the valve must NOT be altered to give pipework offsets. If needed this must be done elsewhere in the flow pipe.
- **3.** The manual valve must be fitted to one of the bottom connections.
- 4. Remove the larger half sheared blanking disc at the appropriate end of the LST enclosure. Support the enclosure and using a hammer and suitable sized punch strike the blanking disc firmly to break its connection, if necessary twist or flex the disc for final removal.
- Complete the fitting of the LST Radiator and fit the enclosure, paying particular attention to fitting the enclosure correctly over the radiator.
- **6.** Push the plastic bush into the hole in the enclosure and ensure that it snaps fully into position.
- Offer up the extension adaptor to the head of the valve by passing it through the bushed hole. Fix securely (without over tightening) making sure that the valve body does not twist.
- **8.** Fit the Thermostatic Valve head to the extension adaptor with the indicator marks aligned as required for operation.


Maintenance Access

For access to the radiator after commissioning, unscrew the knurled ring to remove the Thermostatic Valve head. Using a suitable spanner unscrew the extension adaptor. The enclosure may now be lifted and opened to give internal access.

Refit the extension adaptor and thermostatic head as initial fitting.



Purmo Group (UK) Ltd. Eastern Avenue, Team Valley, Gateshead NE11 OPG, UK T: +44 (0) 845 402 3434, F: +44 (0) 191 491 7568, generalenquiries@purmogroup.com

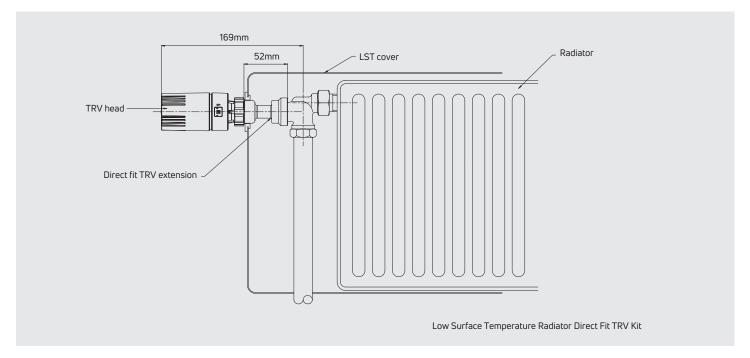

Temperature Limiting - Locking no longer available

Your Purmo Group Thermostatic Radiator valve has a max / min limited range adjustment facility to prevent unauthorised adjustment in public areas or by children in the home.

High Limit

To set the valve temperature to the highest required level, turn the TRV head to your preferred max setting, insert the limit tool and press the Wheelhead 1-2mm until it stops. Then remove the limit tool and press the Wheelhead again until it stops.

Low Limit

To set the valve temperature to the lowest required level, turn the TRV head to your preferred min setting, insert the limit tool and press the Wheelhead 1-2mm until it stops. Then remove the limit tool and press the Wheelhead again until it stops.

Once complete, turn the Wheelhead to the temperature you require and pull the Wheelhead until it stops.

IMPORTANT

When removing the radiator replace the selector head with the manual commissioning cap supplied, and close the valve fully.

Setting Valve

Set the TRV2 to the desired comfort level.

Technical Information

Maximum operating static pressure	10bar	Normal Setting	Ca 20°C
Maximum water temperature	120°C	Frost Setting	8°C
Hysteresis	<0.5K	Limiting and Locking	Ca 1°C
Setting Range	8 - 28°C	Maximum Differential Pressure	0.6bar

Siting of TRV's

A TRV should be positioned where it is able to sense the air temperature changes in the room. It should not be in direct sunlight or in a location that does not allow adequate circulation of air, such as behind curtains or doors or in the corner of a room. In situations

where optimum positioning is not possible a Purmo Group Remote Sensor (Code No. REMSENHEAD2) or a Purmo Group Remote Adjuster (Code No. REMADJHEAD2) should be used.

Automatic By-Pass Valves (ABV's)

It is recommended that a Purmo Group Automatic By-Pass Valve be fitted between the flow and return immediately after the pump in systems having Thermostatic Radiator Valves installed. Where a combination boiler is installed, or the pump head capacity is greater than 0.6bar (6m water gauge) it is essential that an Automatic By-Pass Valve is fitted.

In larger systems it may be necessary to fit more than one ABV in order to prevent the differential pressure in any one leg of the system exceeding the stated maximum.